



SHEET NOTES


- 1 CLEAN SIDE OF COMPUTER RM. MINIMIZE DEBRIS DURING RELOCATION WORK.
- 2 DIRTY SIDE OF COMPUTER RM. INCLUDES DEMOLITION, RELOCATION OR NEW WORK.
- 3 TEMPORARY WALL (ABOVE) AND PERMANENT WALL (BELOW) FLOOR PRIOR TO ANY WORK.

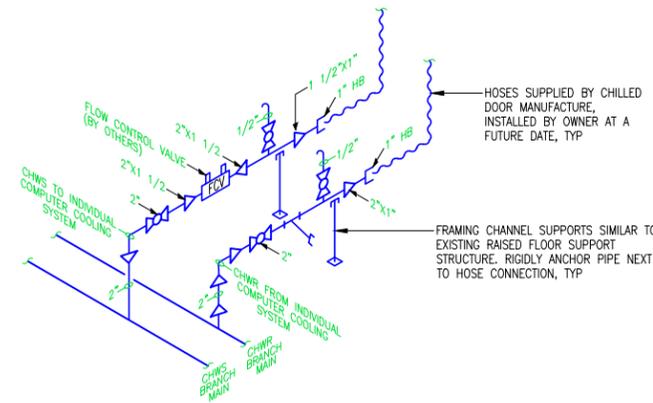

**(A) CHWS/CHWR ISO PIPING DIAGRAM**  
SCALE: NONE

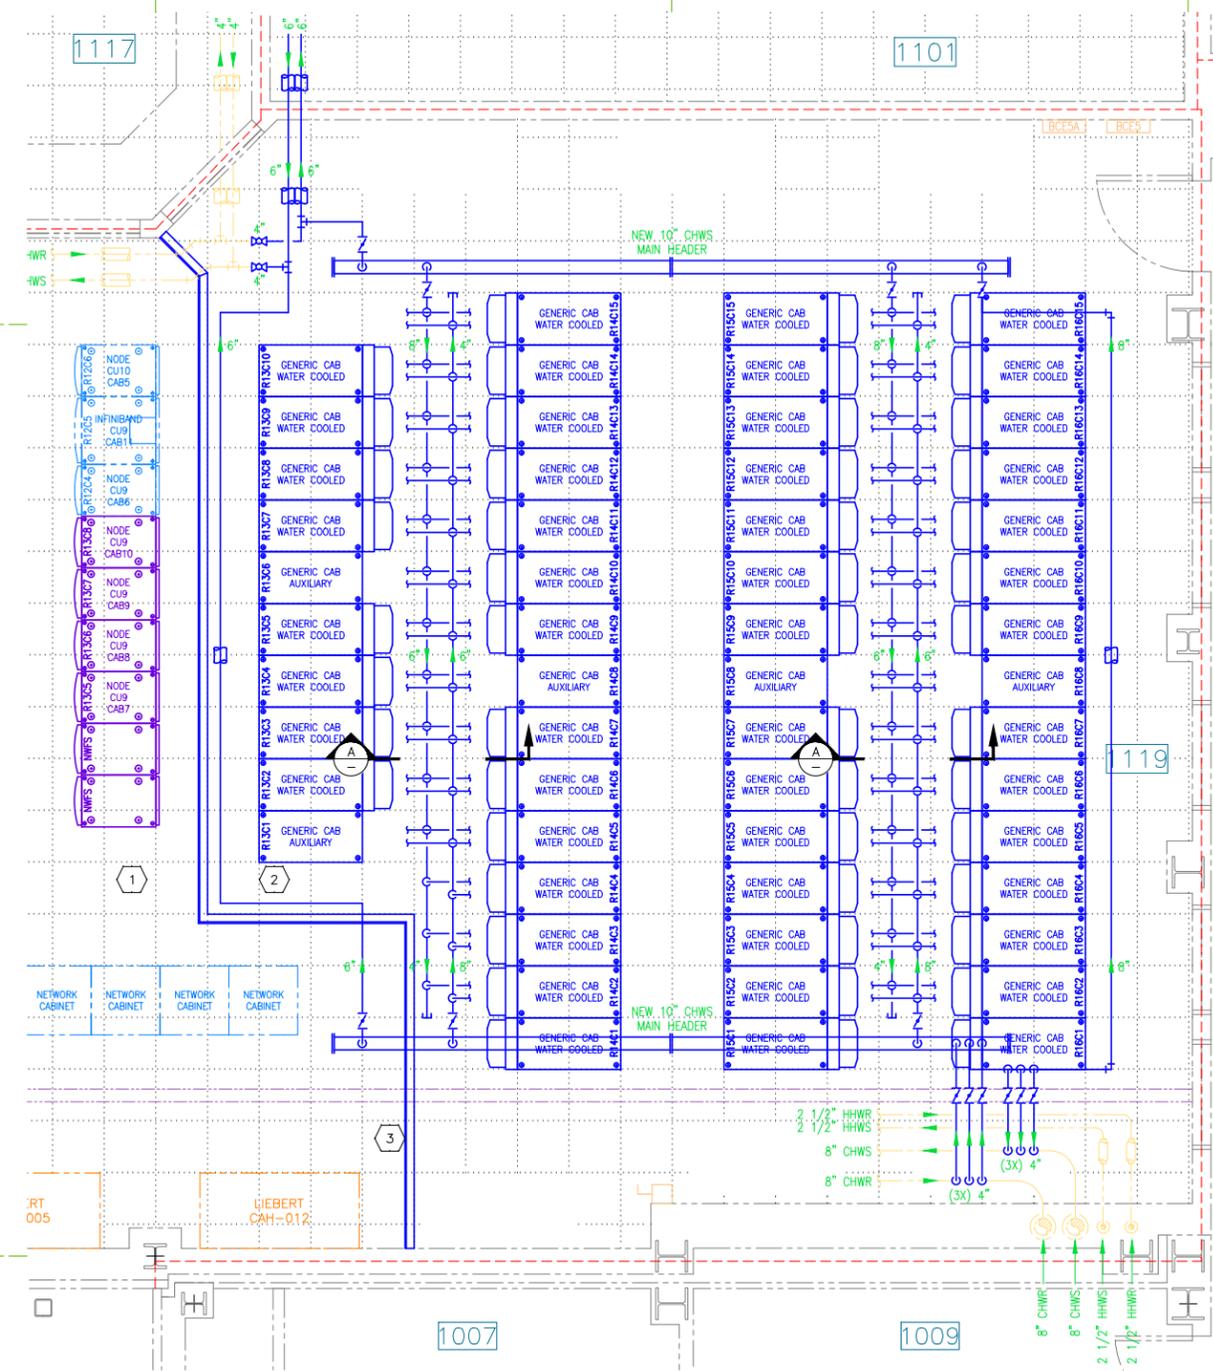

**(1) COMPUTER RM PARTIAL PLAN - BELOW FL**  
SCALE: 3/8" = 1'-0"

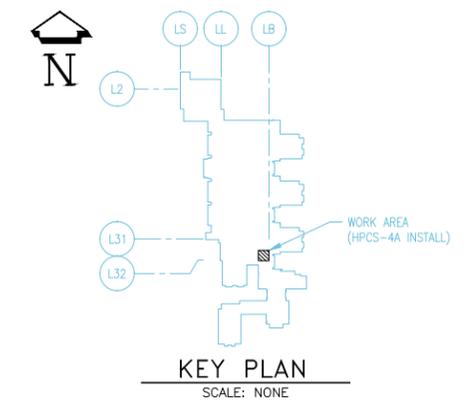

**KEY PLAN**  
SCALE: NONE

**CONCEPTUAL**  
NOT APPROVED FOR CONSTRUCTION  
RFP VENDOR DOWNLOAD

DRAWN KS KOSCHIK		DATE 2/2/12	U. S. DEPARTMENT OF ENERGY PACIFIC NORTHWEST SITE OFFICE	
CHECKED			Pacific Northwest Division <b>Battelle</b> Richland, Washington 99352	
ENGR KM WALTERSKIRCHEN			MECHANICAL CHWS/CHWR BELOW FL LAB 1119 PARTIAL PLAN	
APVD			HPCS-4A INSTALL/EMSL SOUTH POWER	
OTHER			EMSL	
APVD FOR IMPLEMENTATION BY NA ON WORKSHEET			WS9568 0	
			SCALE SHOWN SHEET 1 OF 1	

DRAWING NO	DRAWING TITLE	GA BY	ENGR BY	CHK BY	REV BY	DESCRIPTION	REV NO
	REFERENCE DRAWINGS						
	NEXT USED ON					REVISIONS	